



ELECTRIC WIRING LAYOUT

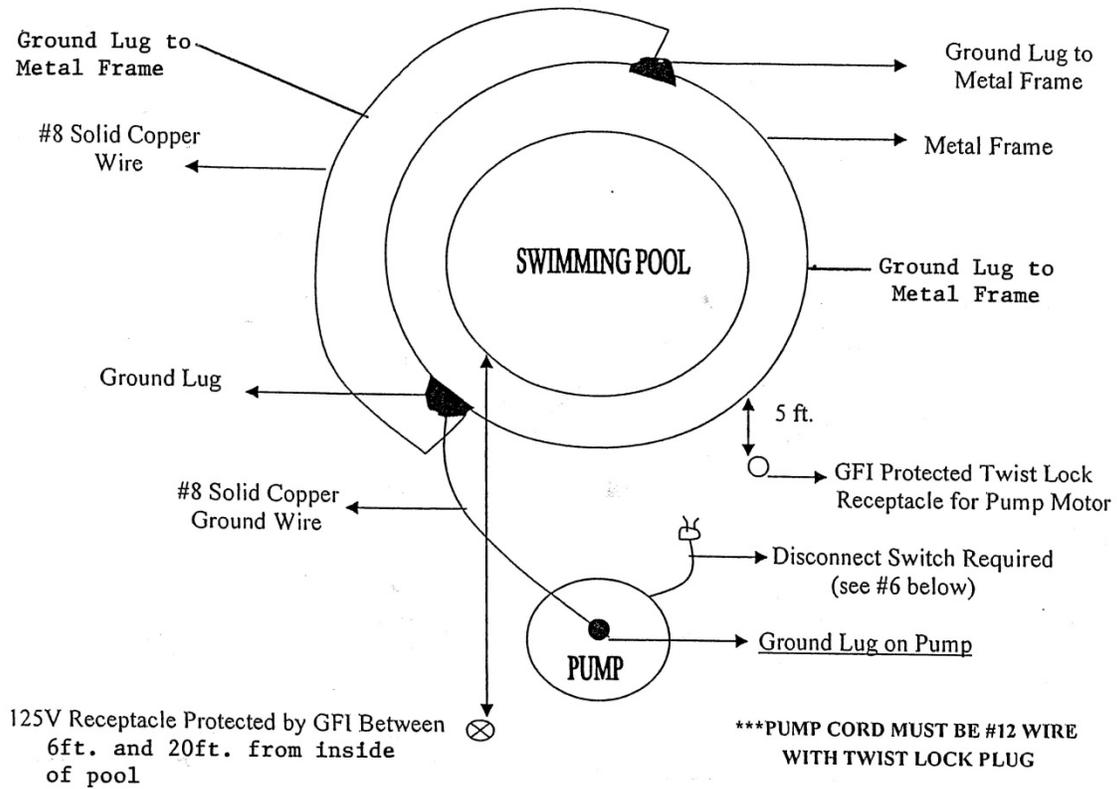

1. Compliance required with N.E.C., Art. 680
2. #8 solid must connect pump and metal frame of pool together - at 4 points plus pool skimmer
3. Run conduit to dwelling, then inside dwelling cable assembly must also have insulated green ground wire, black hot and white neutral
4. Conduit buried 18 inches (Keep open for inspection)

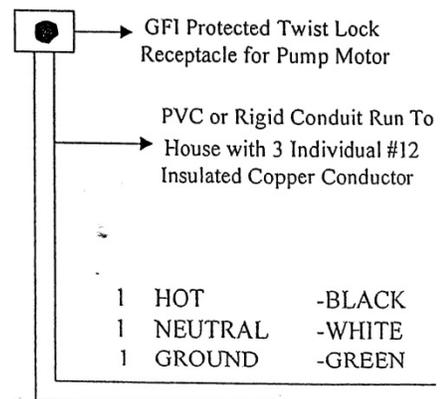

5. ***Before inspection: Pool must be complete & 18" ditch kept open**
6. Disconnect switch required at least 5 ft. from pool horizontally or located within sight